

THE WERI WELL ON TRUK:
A SOLAR PHOTOVOLTAIC PUMPING PROJECT

By

Stephen J. Winter

Larry D. McCleary

Robert D. Watters

UNIVERSITY OF GUAM

Water and Energy Research Institute
of the
Western Pacific

Technical Report No. 39

September, 1983

Partial Project Completion Report
for
Truk State Government
Federated States of Micronesia

TABLE OF CONTENTS

	Page
LIST OF FIGURES	iv
LIST OF TABLES	v
INTRODUCTION	1
OBJECTIVES AND SCOPE.	2
DESIGN	2
SITE SELECTION	10
INSTALLATION	13
OPERATION.	26
MAINTENANCE.	26
CONCLUSIONS	27
ACKNOWLEDGEMENTS	27

LIST OF FIGURES

	Page
1. A completed "WERI Well" installation.	3
2. Assembly drawing of the "WERI Well"	4
3. "WERI Well" wiring diagram.	6
4. Pump curve for Rule 400 pump and two Solar Power Corporation LG160-12 solar panels	6
5. Solar panels on rooftop	8
6. Solar panels on standard pole mount at a location remote from well	8
7. Use of an existing well for a modified "WERI Well" installation.	9
8. Pouring a slab to seal an existing well for a modified "WERI Well" installation.	9
9. Digging below the water table from within a 55 gallon drum.	11
10. Typical piping arrangement and faucet location at storage tank.	11
11. Typical site for "WERI Well" installation	12
12. The "WERI Well" kit	12
13. Digging the hole.	13
14. Disinfecting the well	13
15. Backfilling with aggregate, step 1.	14
16. Placing the well casing	14
17. Backfilling with aggregate, step 2.	15
18. Placing the plastic liner	15
19. Backfilling with sand.	16
20. Cutting the well casing.	16
21. Connecting the pump and hose	17
22. Connecting the well pipe and hose.	17
23. Installing the pump.	18
24. Installing the well cap.	18
25. Measuring the well pipe.	19
26. Cutting the well pipe.	19
27. Installing the union/elbow assembly.	20
28. Removing the well pipe/pump assembly	20
29. Attaching the galvanized pipe.	21
30. Spraying the pipe.	21
31. Installing the solar panels.	22
32. Connecting the wiring, step 1.	22
33. Connecting the wiring, step 2.	23
34. Insulating the connection.	23
35. Reinstalling the pump.	24
36. Running the ½ in PVC pipe.	24
37. Pouring the slab	25
38. Energizing the pump.	25

LIST OF TABLES

	Page
1. List of material for "WERI Well"	5

INTRODUCTION

Truk State is one of the four states in the Federated States of Micronesia. It consists of all the islands in Truk lagoon (hereafter referred to as Truk), the Mortlock Islands south of Truk, and a number of atoll islands to the west and north of Truk. All of these islands are located in the Eastern Caroline Islands roughly between 148° and 154° east longitude and 5° and 9° north latitude. The only high volcanic islands in Truk State are located within the Truk lagoon. All the other islands in the State are low and coralline and are generally situated on the reefs defining the various atolls.

Truk enjoys a tropical island climate with an average daily temperature of approximately 81° F. The average annual rainfall for Truk is approximately 145 inches; however, the rainfall is not uniform and distinct wet and dry seasons occur. The rainfall may vary significantly from year to year and droughts are common. The climate on the other islands in Truk State is similar, although accurate weather data are not available.

Most of Truk State is not served by central water supply and sewer systems. In these areas, traditional methods of obtaining potable water and disposing of wastewater must be used. Sources of potable water on high islands include streams, springs, shallow wells, and rainwater catchment systems. On low islands streams and springs are not available. Wastewater from washing clothing and kitchenware and from bathing is simply allowed to fall to the ground in the washing area. Toilet facilities consist of over-land or over-water benjos (outhouses) or water-sealed toilets.

Unfortunately, traditional methods of water supply in Truk State often do not provide water of adequate quality and in sufficient quantity. Surface and groundwater are often contaminated because of animal and human wastes. Rooftop catchment systems, which produce the highest quality water, generally are not functional during the dry season (January through March) because of insufficient catchment area and/or storage capacity. Perennial streams do not exist in all villages and, in the dry season, the yield of shallow wells may be seriously reduced or eliminated completely. The result is great inconvenience for the local people (i.e., carrying water for a long distance), compounded by increased consumption of water of marginal quality (i.e., no rooftop water available).

During the past year (1982) a cholera epidemic took place in Truk State. This emphasized the need for safe potable water supplies and, as a result, funds from the U.S.A. became available for assistance with a number of projects:

1. construction of water-sealed toilets
2. construction of ferro cement rainwater storage tanks
3. construction of shallow solar-powered (photovoltaic cell) wells

This report describes portions of the third project.

OBJECTIVES AND SCOPE

The Water and Energy Research Institute (WERI) was contracted by the Truk State government to perform a number of tasks:

1. Design a simple "standard" solar pumping system suitable for extracting ground water from low atoll islands or flat sandy coastal areas of high islands.
2. Provide an illustrated instruction manual for the installation of such systems.
3. Procure hardware required for the installation of a minimum of 150 such systems.
4. Install approximately 25 such systems.
5. Train Rural Sanitation Program personnel in the installation of such systems.
6. Design, procure hardware for, and install "special" solar pumping systems as required. Such systems might involve pumping larger quantities of water, pumping to higher elevations, pumping over longer distances, etc.

This report covers the design and installation of the "standard" solar pumping system (items 1 and 4 above).

DESIGN

Figure 1 is a photograph of a completed installation of a "standard" solar pumping system, hereafter referred to as a "WERI Well". Figure 2 is an assembly drawing for the "WERI Well" and Table 1 is a listing of all components of the well and their function. Figure 3 is the wiring diagram for the well.

The principle of operation of the "WERI Well" is quite simple. The solar panels, composed of photovoltaic cells, generate D. C. electricity at approximately 12 volts when they are exposed to sunlight. A small 12 volt submersible marine bilge pump is wired to the panels and operates whenever the panels generate sufficient power.

The "WERI Well" was designed to incorporate a number of features:

1. Simplicity/reliability. There is only one moving part in the system, the 12 volt marine bilge pump. There are no batteries, voltage regulators, switches, etc.
2. Ease of maintenance. It is probable that the only component of the system that may fail is the pump. Its cost is approximately \$8; it is expendable and can be replaced in minutes.



Figure 1. A completed "WERI WELL" installation.

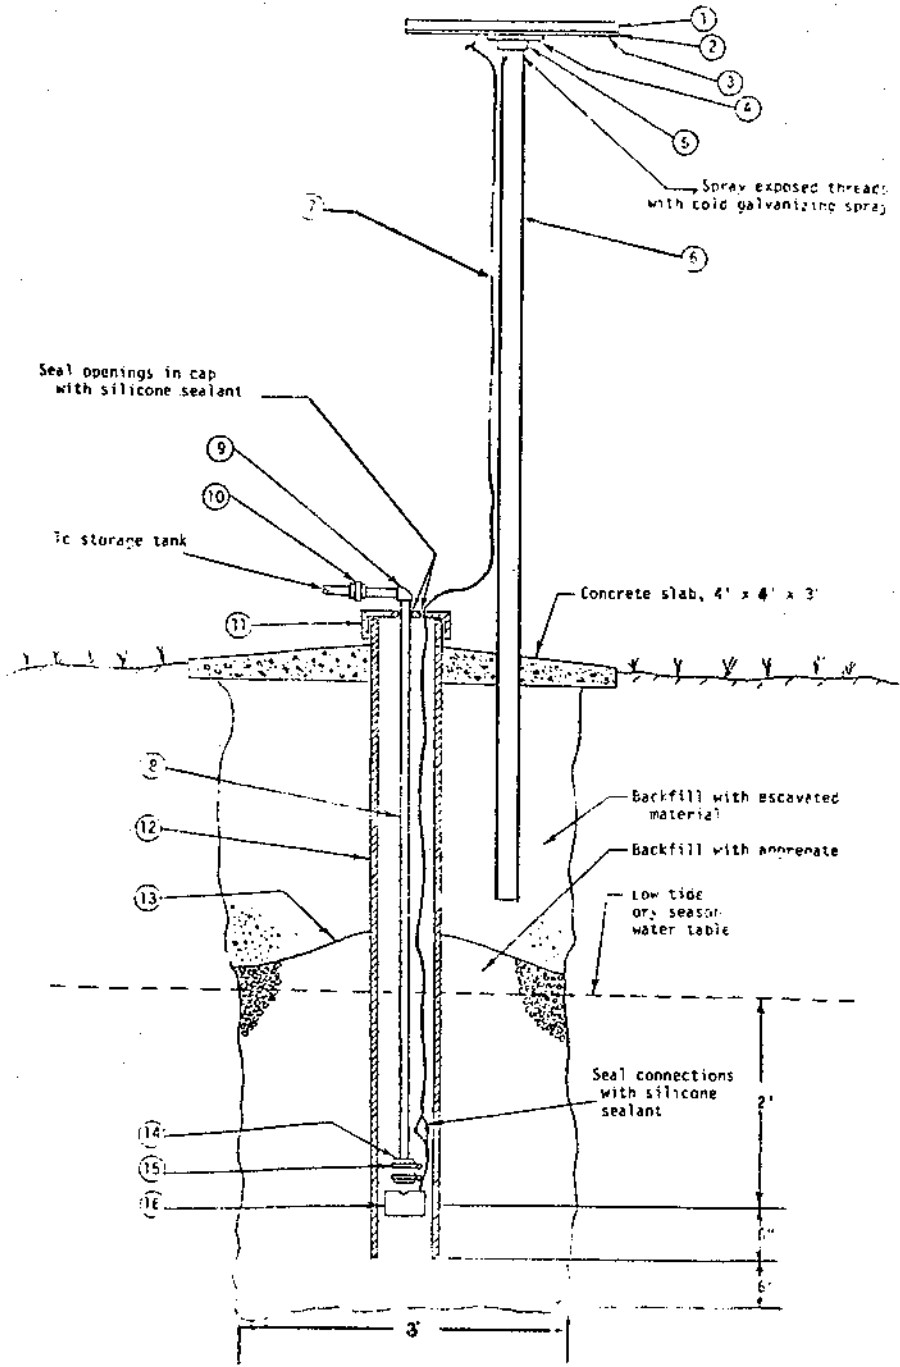


Figure 2. Assembly drawing of the "WERI Well." (not to scale)

Table 1. List of material for "WERI Well".

Item No.	Quantity	Description	Function
1	2	28 watt solar module, SPC LG160-12	generates 12v electricity from sunlight
2	1	2'x4'x $\frac{1}{2}$ " marine plywood, treated & painted	mounting for solar modules
3	8	$\frac{1}{4}$ " x 20 x 1" long, aluminum hex head cap screws, nuts, and washers	fastens solar modules to plywood mounting
4	5	$\frac{1}{4}$ " x 20 x $\frac{1}{2}$ " long galvanized carriage bolts, nuts, and washers	fastens plywood mounting to flange
5	1	2" galvanized steel floor flange	connects 2" pipe to solar module assembly
6	10' provided	2" galvanized steel water pipe (threaded on one end)	support for solar module assembly
7	20' provided	16-2 stranded wire	connects pump and solar module
8	40' provided	$\frac{1}{2}$ " PVC water pipe	connects pump to storage tank (not shown)
9	6 provided	$\frac{1}{2}$ " PVC elbow (socket ends)	provides for changes in pipe direction
10	1	$\frac{1}{2}$ " PVC union (socket ends)	permits easy assembly and disassembly of well
11	1	6" PVC end cap	protects well from contamination
12	10' provided	6" PVC pipe	well casing
13	1	plastic sheet	prevents sand from entering aggregate
14	1	1" diameter x 6" long rubber hose	connects pump to $\frac{1}{2}$ " PVC pipe
15	2	1" stainless steel hose clamp	clamps hose to pipe and pump
16	1	Rule 400 gph pump	pumps water from well

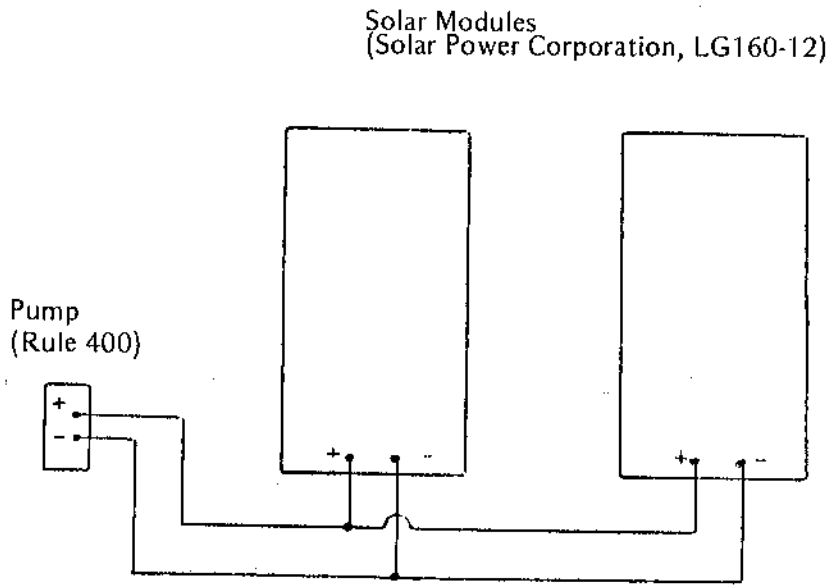


Figure 3. "WERI Well" wiring diagram.

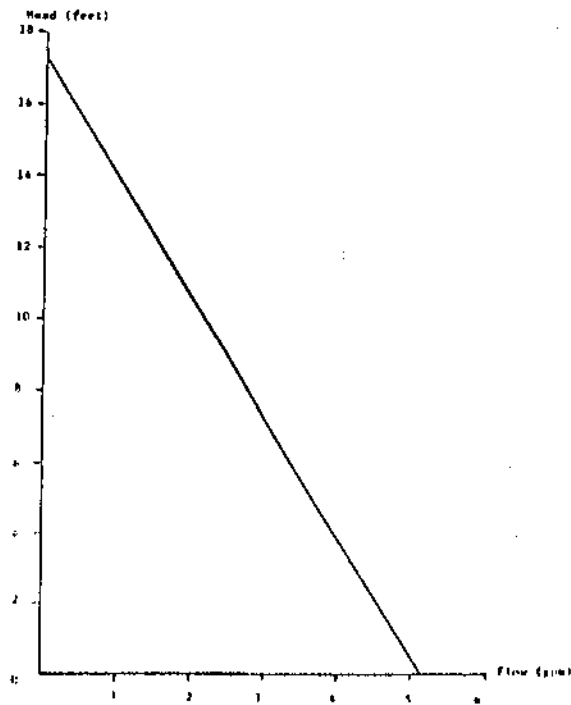


Figure 4. Pump curve for Rule 400 pump and two Solar Power Corporation LG160-12 solar panels.

3. Assistance to rainwater catchment systems. The system operates "at the will of the sun". It is intended to complement a roof top rainwater catchment system. The well will function on clear/dry days; rainwater catchment systems function on cloudy/rainy days.
4. Ease of construction. After the hole is dug and the required amount of aggregate gathered, the installation of the system takes approximately 2 hours.
5. Improved sanitation. The well is sealed from surface runoff which minimizes the risk of contamination from this source. However, it is emphasized that water from the well should not be used for drinking unless proved safe by bacteriological tests.
6. Low cost. The cost per system is less than \$1,000.
7. Overpumping difficult. The pumping rate for the well at 14 ft head (from water table to top of tank) is approximately 1 gpm (400 gal per day). It increases to approximately 2 gpm (800 gal per day) at 10 ft head. Figure 4 is a pump curve for the well. At these low pumping rates, it is very difficult to cause sea water intrusion or to pump the well dry.

Sometimes special field conditions dictate that modifications to the design are necessary. Three common conditions are:

1. Installation of the solar panels on a roof top (Figure 5) or installation of the panels and galvanized mounting pole at a location remote from the well (Figure 6) in order to maximize exposure to sunlight. The length of wire from the panels to the pump should not exceed 100 ft. The following minimum wire sizes are recommended:

<u>length of wire</u>	<u>wire size</u>
less than 50 ft	no. 16 (supplied with "WERI Well" kit)
50 to 75 ft	no. 14
75 to 100 ft	no. 12

In all cases, stranded wire should be used.

2. Use of an existing well. Sometimes it is convenient to place the pump in an existing well rather than dig a new one. The well can be back filled with aggregate and covered with a concrete slab as in the "WERI Well" design (Figure 7) or a reinforced slab can be poured elsewhere, cured, and laid on the well. Generally, a short piece of well casing (approximately 2 ft) is bonded to the slab to serve as a convenient location for mounting the $\frac{1}{2}$ in PVC well pipe (Figure 8).



Figure 5. Solar panels on rooftop.



Figure 6. Solar panels on standard pole mount at a location remote from well.



Figure 7. Use of an existing well for a modified "WERI WELL" installation.



Figure 8. Pouring a slab to seal an existing well for a modified "WERI WELL" installation.

3. Installation of a 55 gallon drum below the water table. In areas where the sand contains little soil, root material, etc. to hold it together, caving can occur when digging below the water table. By digging from within a 55 gallon drum (with top and bottom removed) while gradually sinking it into the sand, caving will not occur (Figure 9). This adds to the safety of the digging operation and will probably increase the overall life of the well. This modification to the "WERI Well" design merits serious consideration in almost all installations.

This report does not specifically address storage tank construction. However, two factors related to well performance are important:

1. The water supply from the well to the tank should be to the top of the tank (Figure 10). If the supply is to the bottom, the head on the pump will decrease considerably and might cause overpumping of the well.
2. A faucet can be placed in the feed line to the tank (Figure 10). On partially cloudy days or when the sun is not too high, the pump may have sufficient power to pump water to the faucet. This will lengthen the period of operation of the well. The faucet should be left closed when not in use.

Of course, the storage tank should be equipped with a drain line, tap, and overflow line.

SITE SELECTION

The following criteria are used to select a site (Figure 11) for installation of a "WERI Well" (Figure 12):

1. Unavailability of public utilities (it is cheaper to use central power if available)
2. Flat sandy coastal area (so well depth will not exceed pumping capability of pump) (Figure 11)
3. Open area (accessibility of sunlight)
4. Government property (preferred) close to a village (so there will not be any land disputes)
5. Away from privys and taro patches (to prevent possible water contamination).



Figure 9. Digging below the water table from within a 55 gallon drum.

Figure 11. Typical site for "WELL WITH" installation.



Figure 10. Typical piping arrangement and faucet location at storage tank.



Figure 11. Typical site for "WERI WELL" installation.



Figure 12. The "WERI WELL" kit.